

PLACE "C" MIX AC MINIMUM THICKNESS OF 4" (2-2" LIFTS) OR THE THICKNESS OF THE REMOVED PAVEMENT, WHICHEVER IS GREATER. COMPACT AS SPECIFIED.

PLACE "C" MIX AC MINIMUM THICKNESS OF 4" (2-2" LIFTS)


SEAL SURFACE OVER JOINT WITH TACK MATERIAL. (AC PATCH ONLY)

EXIST. PAVEMENT

MIN.

MIN.

EXIST. PAVEMENT

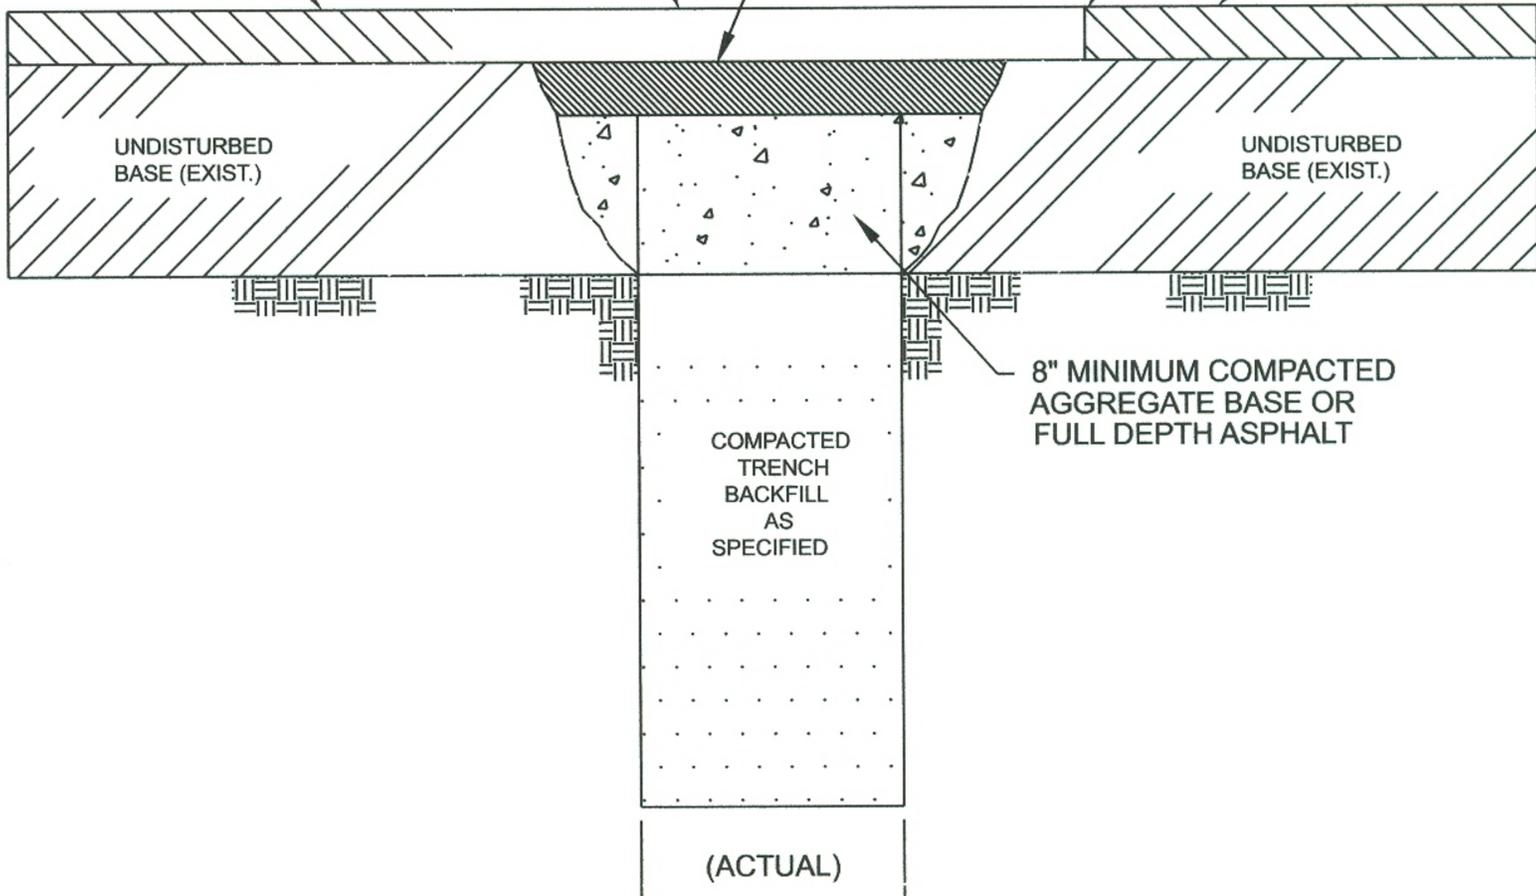

NOTES:

- 1) ALL EXISTING AC OR PCC PAVEMENT SHALL BE SAWCUT 12" FROM EDGE OF TRENCH PRIOR TO PAVING.
- 2) CONCRETE PAVEMENT SHALL BE REPLACED WITH CONCRETE TO A MINIMUM THICKNESS OF 6" OR TO THE THICKNESS OF REMOVED PAVEMENT, WHICHEVER IS GREATER.
- 3) USE HOT CLASS "C" A.C. MIX WHEN POSSIBLE. COLD A.C. MIX SHALL BE REPLACED WITH HOT A.C.

- 4) ALL TRENCHING AREAS TO BE BACKFILLED WITH  $\frac{3}{4}$ " MINUS ROCK IN ONE-FOOT LIFTS AND COMPACTED TO 95% OF MAXIMUM DENSITY AS PER AASHTO T-99 METHOD C, OR CONTROLLED DENSITY FILL.



DETAIL FOR  
STREET CUT

DATE: Nov 2004

DRAWING NO.